



**SERVICE METER ASSEMBLY
PER STD DETAIL W-02**

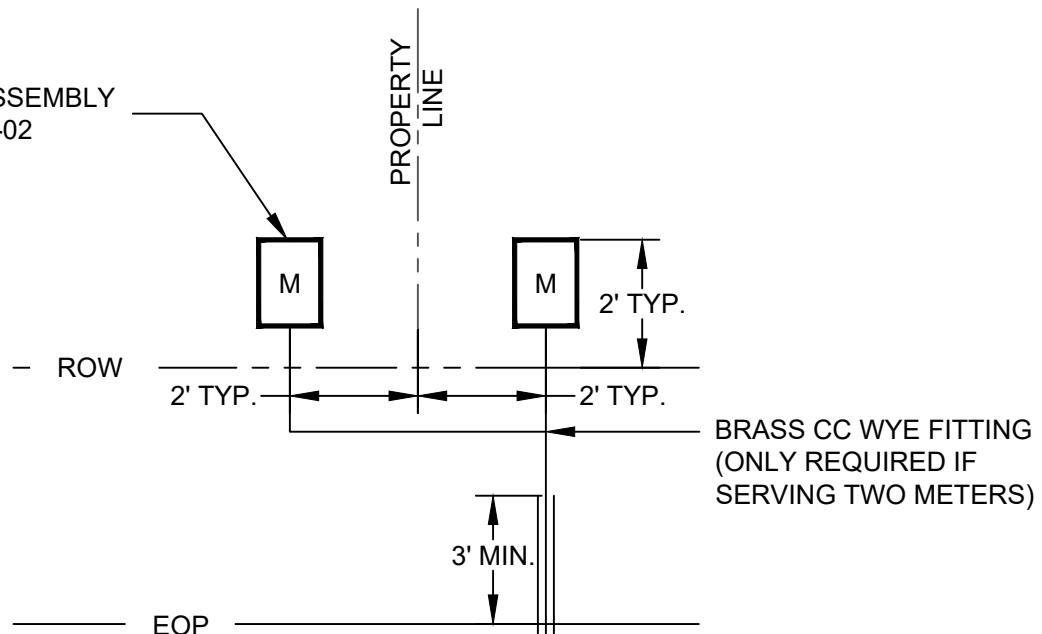

RESIDENTIAL SERVICE LINE NOTES:

1. TO SERVICE TWO (2) RESIDENTIAL METERS ON A COMMON PROPERTY LINE, SERVICE TAP SHALL BE ONE (1") INCH, WITH ONE (1") INCH DIA. MUNICIPEX INSTALLED UNDER PAVEMENT WITHIN A TWO (2") INCH PVC CASING, THEN SPLIT BY A $1" \times \frac{3}{4"} \times \frac{3}{4"}$ CC Q NUT WYE. $\frac{3}{4"}$ DIA. MUNICIPEX SHALL BE INSTALLED FROM WYE TO EACH METER.
2. TO SERVICE ONE (1) RESIDENTIAL METER SERVICE TAP SHALL BE $\frac{3}{4"}$, WITH $\frac{3}{4"}$ DIA. MUNICIPEX INSTALLED UNDER PAVEMENT WITHIN A TWO (2") INCH PVC CASING

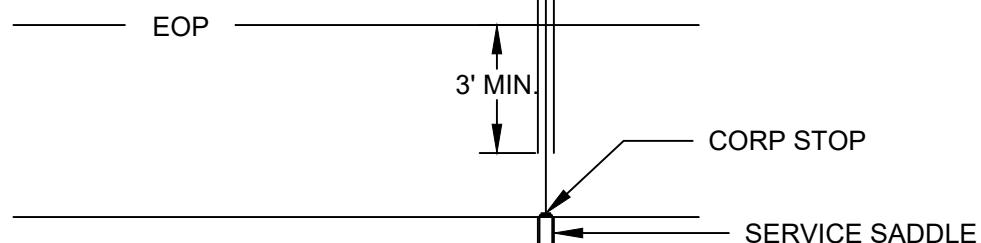

NOTES:

NOTE:

1. ALL LONG SIDE RESIDENTIAL SERVICES SHALL HAVE PVC CASING PIPE EXTENDING 3 FT OUTSIDE THE EDGE-OF-PAVEMENT (EOP). FOR $\frac{3}{4}$ "-1" SERVICE - 2" CASING
2. FOR ALL LONG SIDE 2" SERVICES, CASING PIPE SHALL BE 3" PVC.
3. SERVICE METERS SHALL BE LOCATED WITHIN 2FT OF THE RIGHT-OF-WAY (ROW). AND PROPERTY LINES.

LONG SIDE WATER SERVICE

N.T.S.



CITY OF PORTLAND

DEPARTMENT OF UTILITIES - WATER

STANDARD WATER DETAILS

REVISION NO: 4
DATE: 06/05/2024

W-03