


HYDRANT CAP COLOR	AVAILABLE FLOW (AT 20 PSI RESIDUAL)
BLUE	1,500 GPM OR MORE
GREEN	1,000 - 1,499 GPM
ORANGE	500 - 999 GPM
RED	BELOW 500 GPM
BLACK	OUT OF SERVICE

NOTES:

1. AS PER NFPA 291, ALL PUBLIC HYDRANTS ARE TO BE YELLOW. ALL PRIVATE HYDRANTS SHALL BE SILVER.
2. CONTRACTOR IS RESPONSIBLE FOR PAINTING CAPS AS PER FLOW PRIOR TO PDU ACCEPTANCE OF WATER MAIN.
3. PRESSURE MONITORING DEVICE WILL BE REQUIRED TO BE INSTALLED WITH ALL SUBDIVISIONS 26 LOTS OR MORE. FOR EVERY 100 LOTS, THERE SHALL BE ONE PRESSURE MONITORING DEVICE INSTALLED ON A HYDRANT.

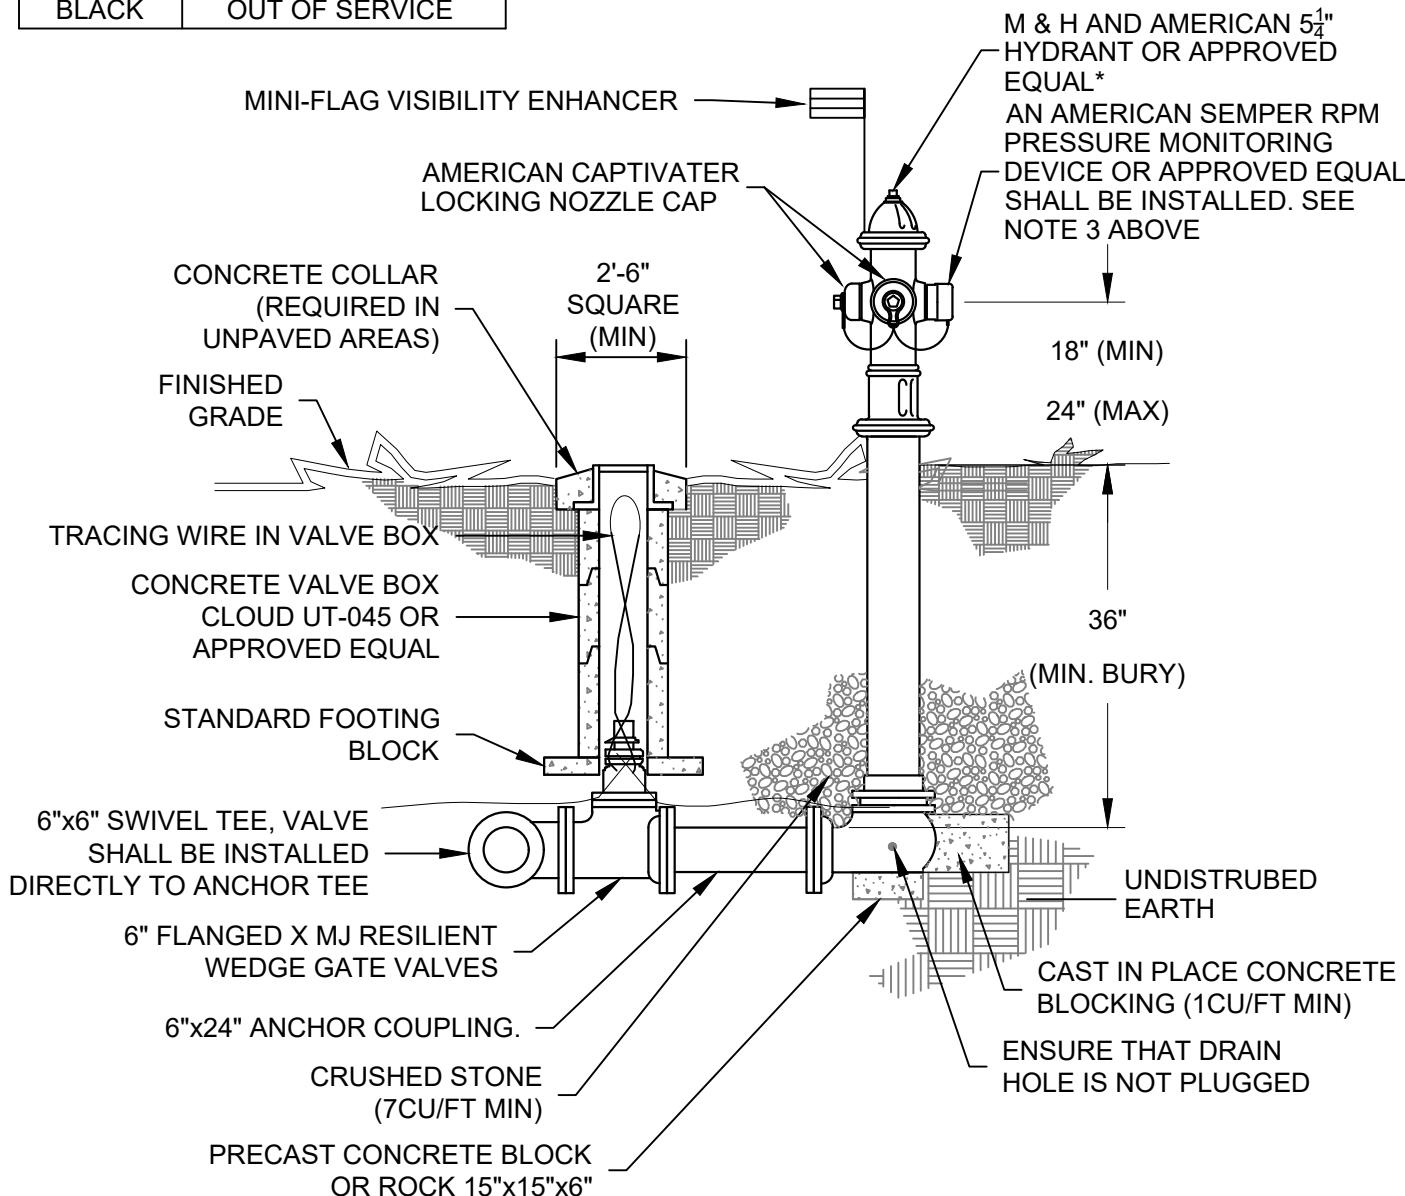

FIRE HYDRANT ASSEMBLY

N.T.S.



CITY OF PORTLAND
DEPARTMENT OF UTILITIES - WATER
STANDARD WATER DETAILS

REVISION NO: 9
DATE:09/20/2024

W-08