


GENERAL NOTES:

1. REDUCER MAY BE REQUIRED TO CONNECT NEW WATERLINE TO THE EXISTING.
2. INSTALL NEW WATERLINE 5' OFF BACK OF EASEMENT.
3. NEW TEE & GATE VALVES SHALL MATCH PROPOSED WATERLINE SIZE.
4. MAINTAIN 20' FROM THE FACE OF VALVE TO THE FACE OF REDUCER BEFORE HYDRANT.

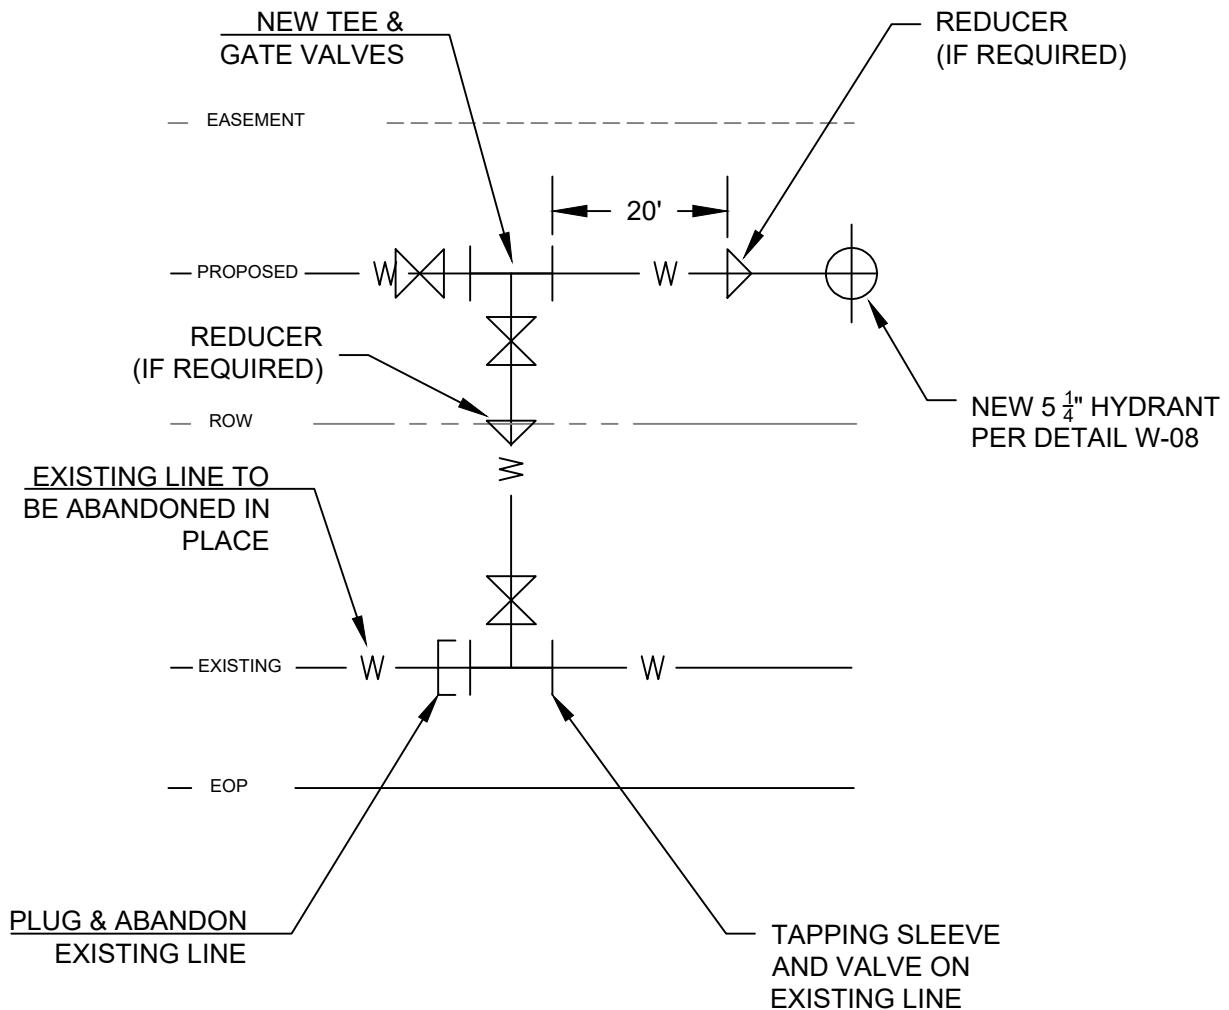

**END OF LINE CONNECTION DETAIL (WITH EASEMENT)**

N.T.S.



**CITY OF PORTLAND**  
DEPARTMENT OF UTILITIES - WATER  
STANDARD WATER DETAILS

REVISION NO: 3  
DATE:06/05/2024

W-16