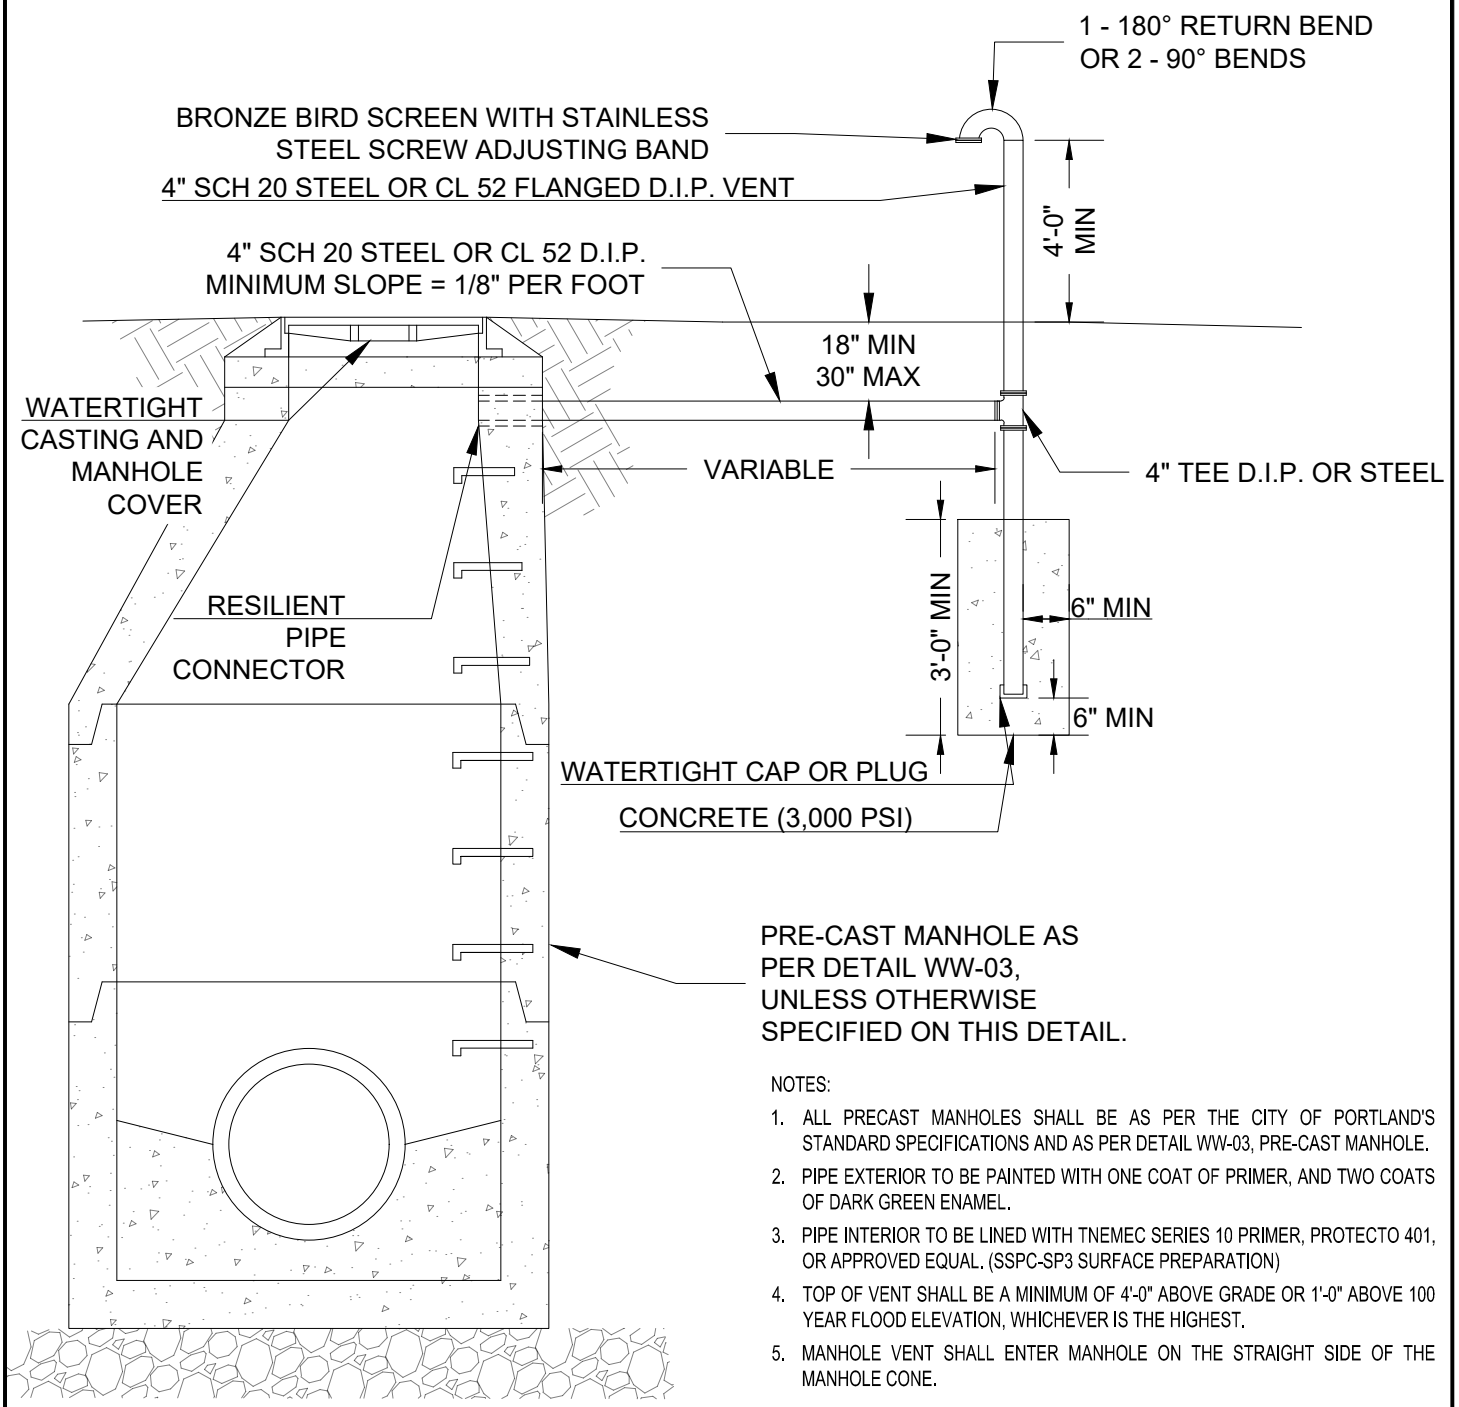

NOTES:

1. ALL PRECAST MANHOLES SHALL BE AS PER THE CITY OF PORTLAND'S STANDARD SPECIFICATIONS AND AS PER DETAIL WW-03, PRE-CAST MANHOLE.
2. PIPE EXTERIOR TO BE PAINTED WITH ONE COAT OF PRIMER, AND TWO COATS OF DARK GREEN ENAMEL.
3. PIPE INTERIOR TO BE LINED WITH TNEMEC SERIES 10 PRIMER, PROTECTO 401, OR APPROVED EQUAL. (SSPC-SP3 SURFACE PREPARATION)
4. TOP OF VENT SHALL BE A MINIMUM OF 4'-0" ABOVE GRADE OR 1'-0" ABOVE 100 YEAR FLOOD ELEVATION, WHICHEVER IS THE HIGHEST.
5. MANHOLE VENT SHALL ENTER MANHOLE ON THE STRAIGHT SIDE OF THE MANHOLE CONE.

MANHOLE VENT ASSEMBLY

N.T.S.

Call 811 Before You Dig!
PORTLAND DEPARTMENT OF UTILITIES
PDU
Portland, Tennessee

CITY OF PORTLAND

DEPARTMENT OF UTILITIES - SEWER
STANDARD SEWER DETAILS

REVISION NO: 3
DATE:06/05/2024

WW-15