



TYPE	YEAR	LINE SECTION	SHEET No.
PRELIM	2024		1

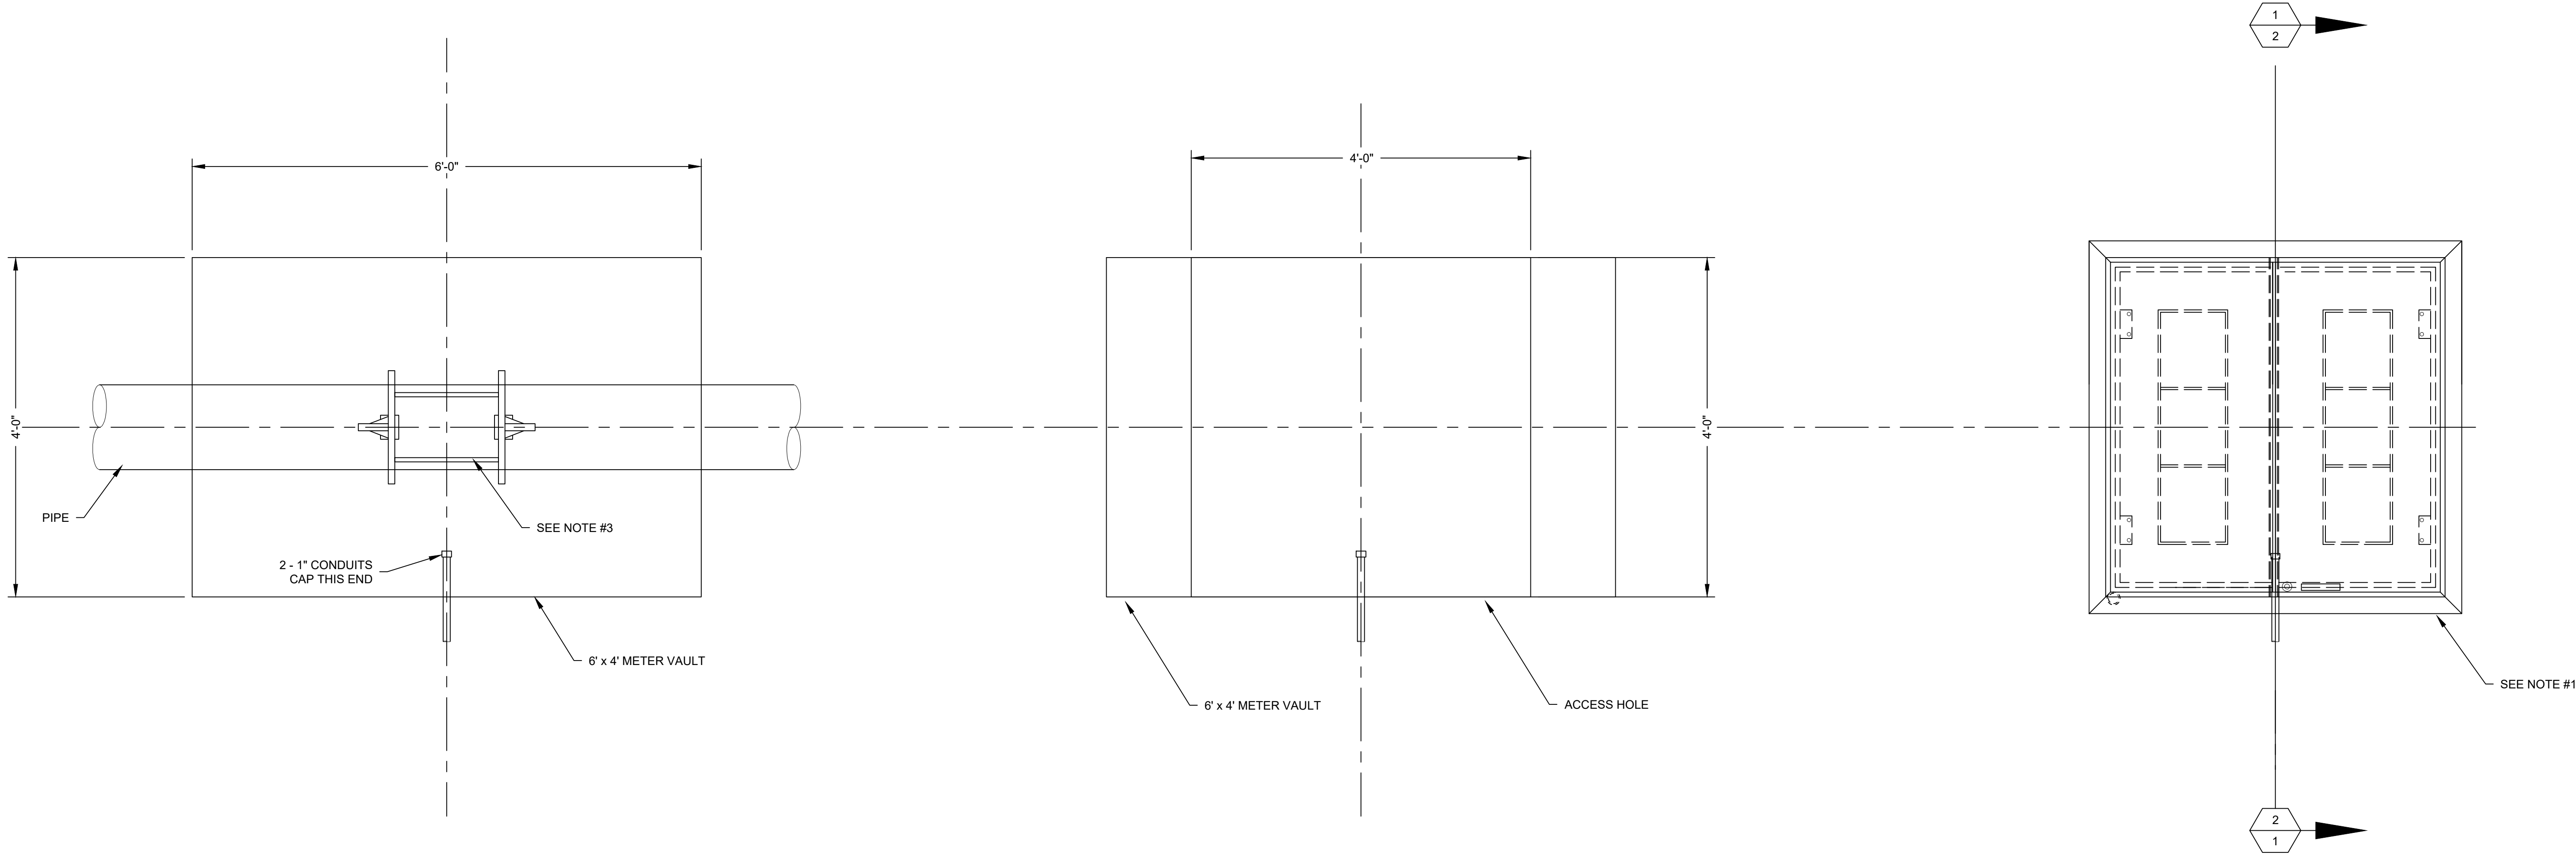

NOTES:

- ACCESS HATCH TO BE HALLIDAY PRODUCTS W2S4242 ALUMINUM HATCH WITH RECESSED PADLOCK BOX.
- BADGER DYNASONIC TFX-500W ULTRASONIC FLOW TRANSMITTER.
- SCADA CABINET TO BE INSTALLED BY CONTRACTOR FOR TOTALIZER, ITRON UNIT, AND GFCI RECEPTACLE.
- METER VAULT CONCRETE MUST BE 4500 PSI @ 28 DAYS AND REINFORCED WITH #4 BAR AT 8" C/C E.W.
- CONTRACTOR INSTALLING MUSE USE PDU METER INSTALLATION TO INSTALL METER AND PROGRAM THE METER.
- LID FOR ASPHALT/HARD SURFACES. FLAT TOP WITH MANHOLE FRAME AND CASTING LID TO BE STAMPED SEWER.

METER VAULT FOR SEWER LINES
N.T.S.


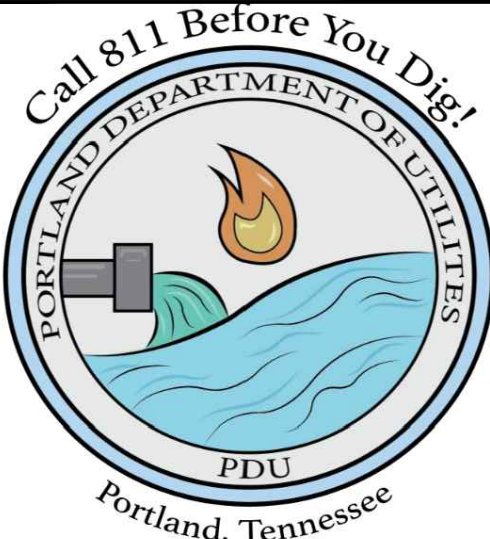


CITY OF PORTLAND
DEPARTMENT OF UTILITIES

REVISION NO: 1
DATE:08/30/2024

WW-17 SHEET #1

TYPE	YEAR	LINE SECTION	SHEET No.
PRELIM	2024		2

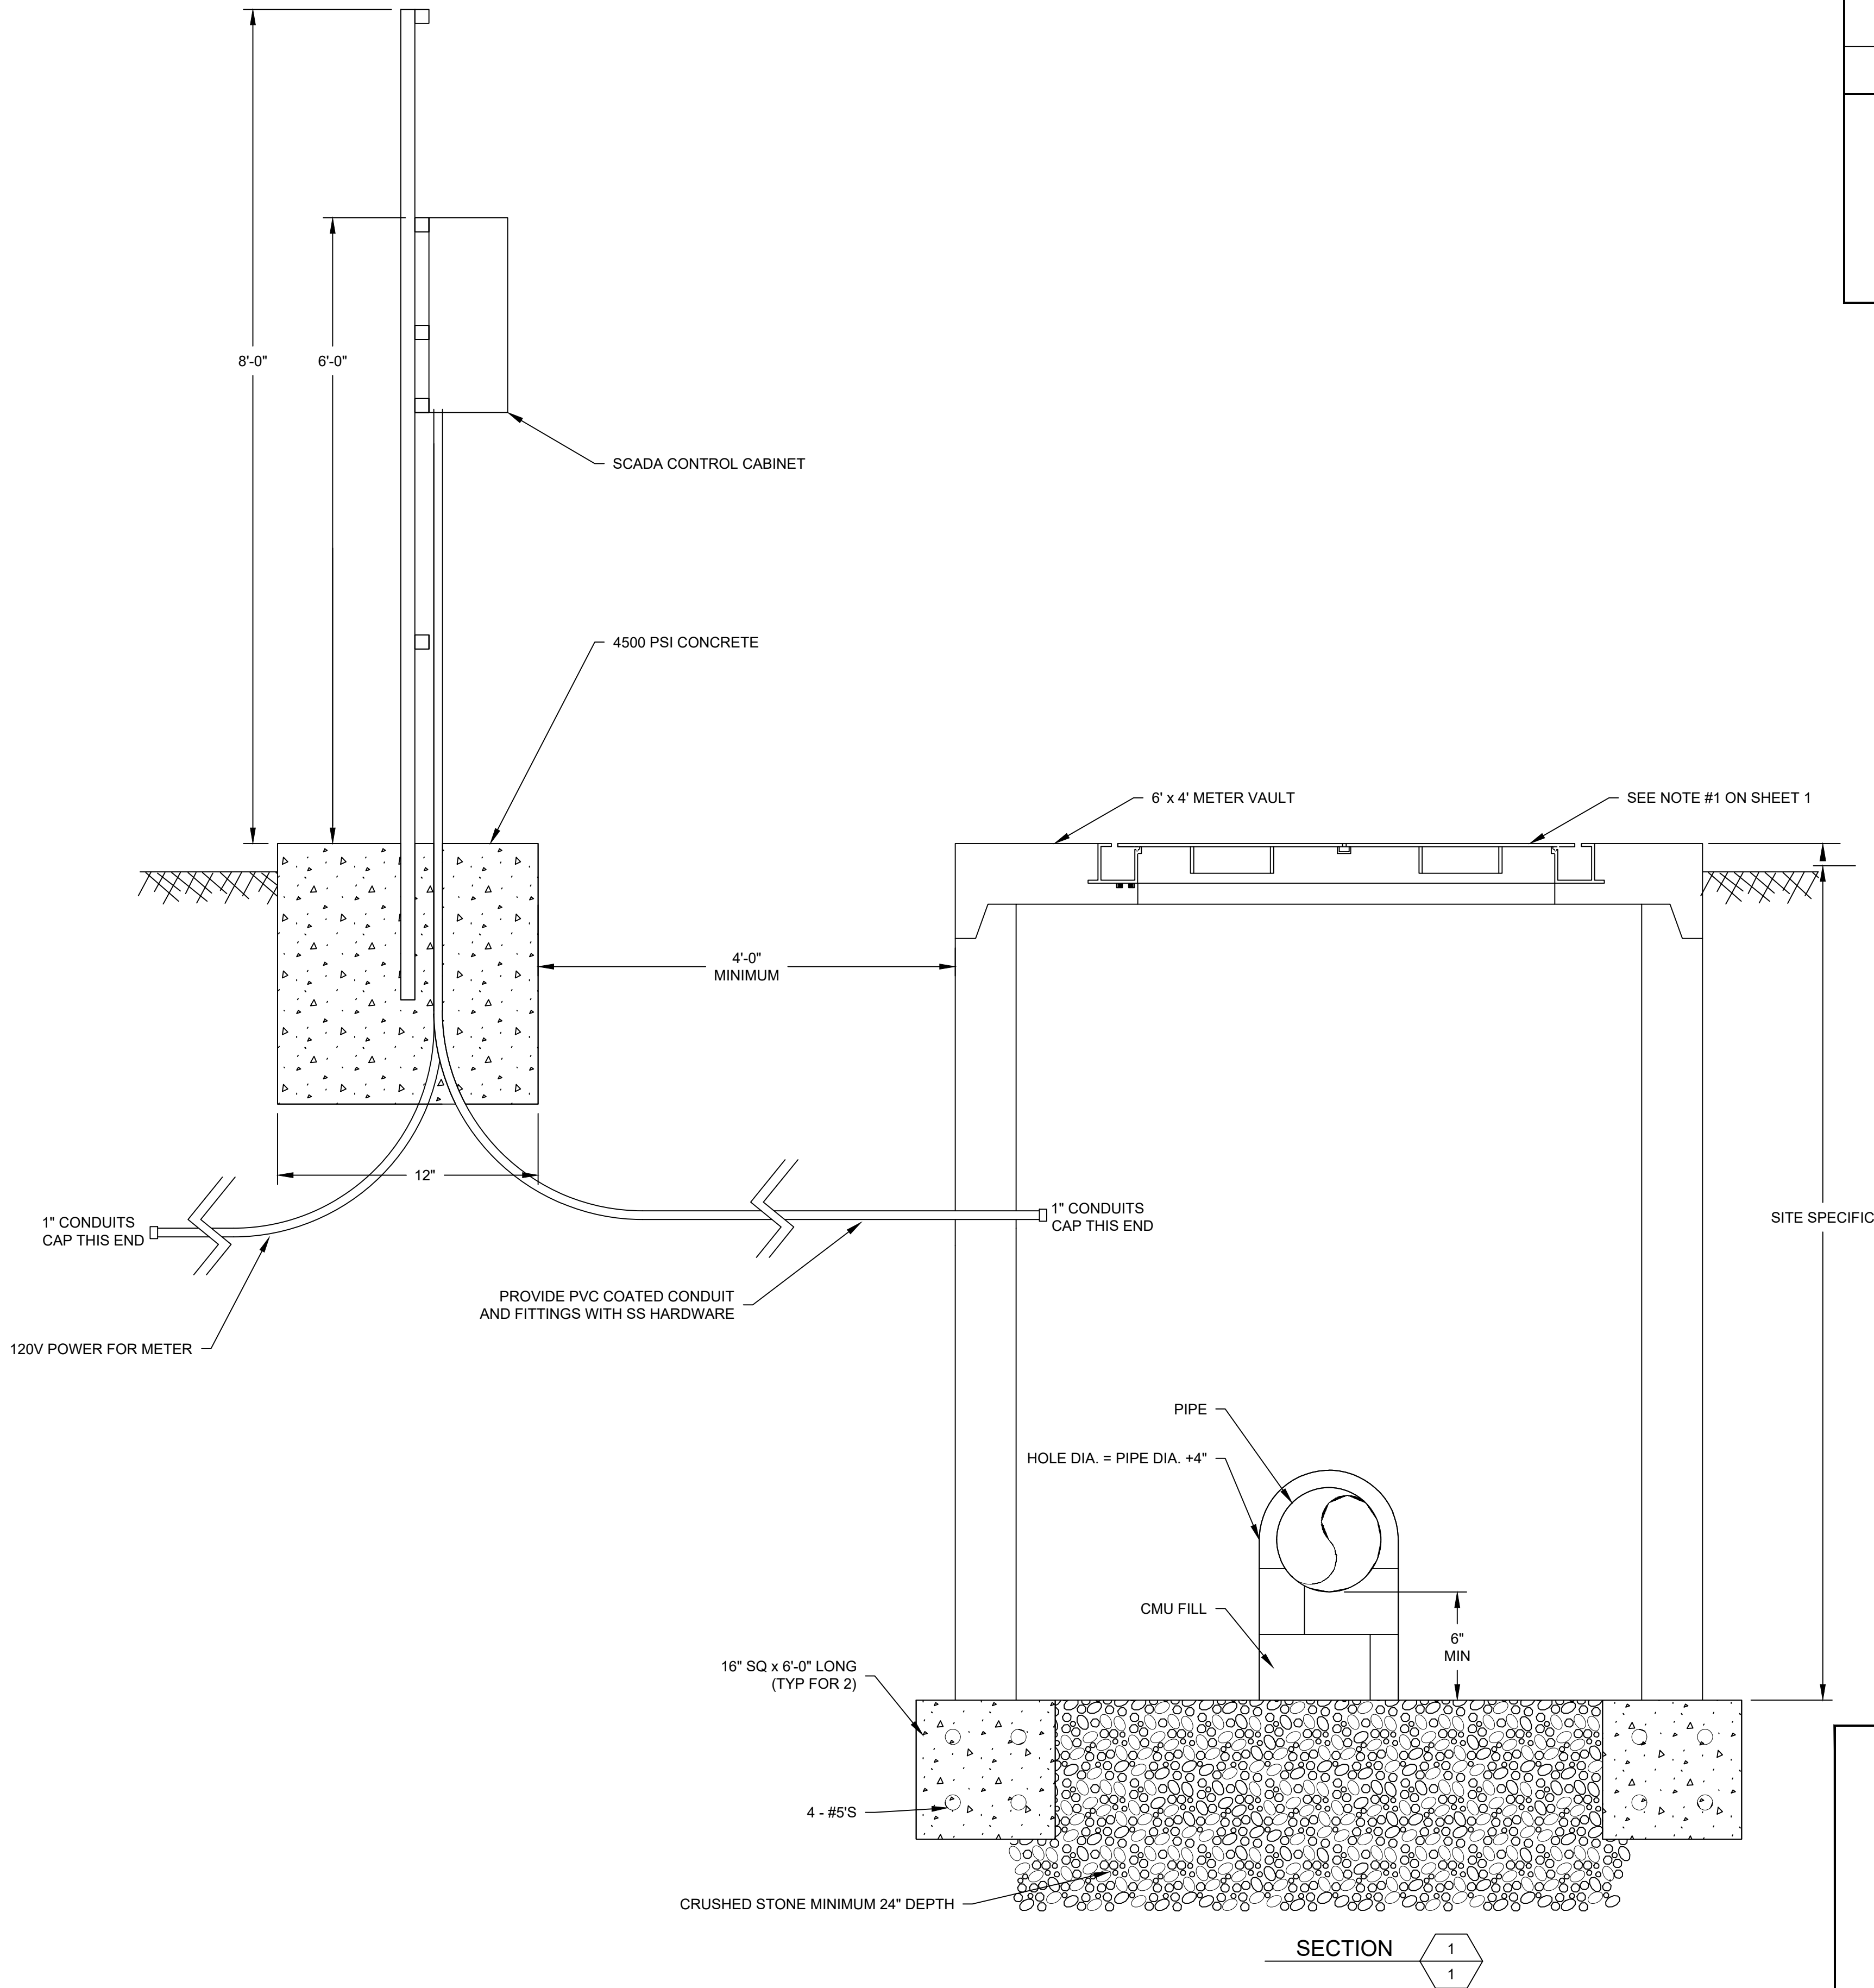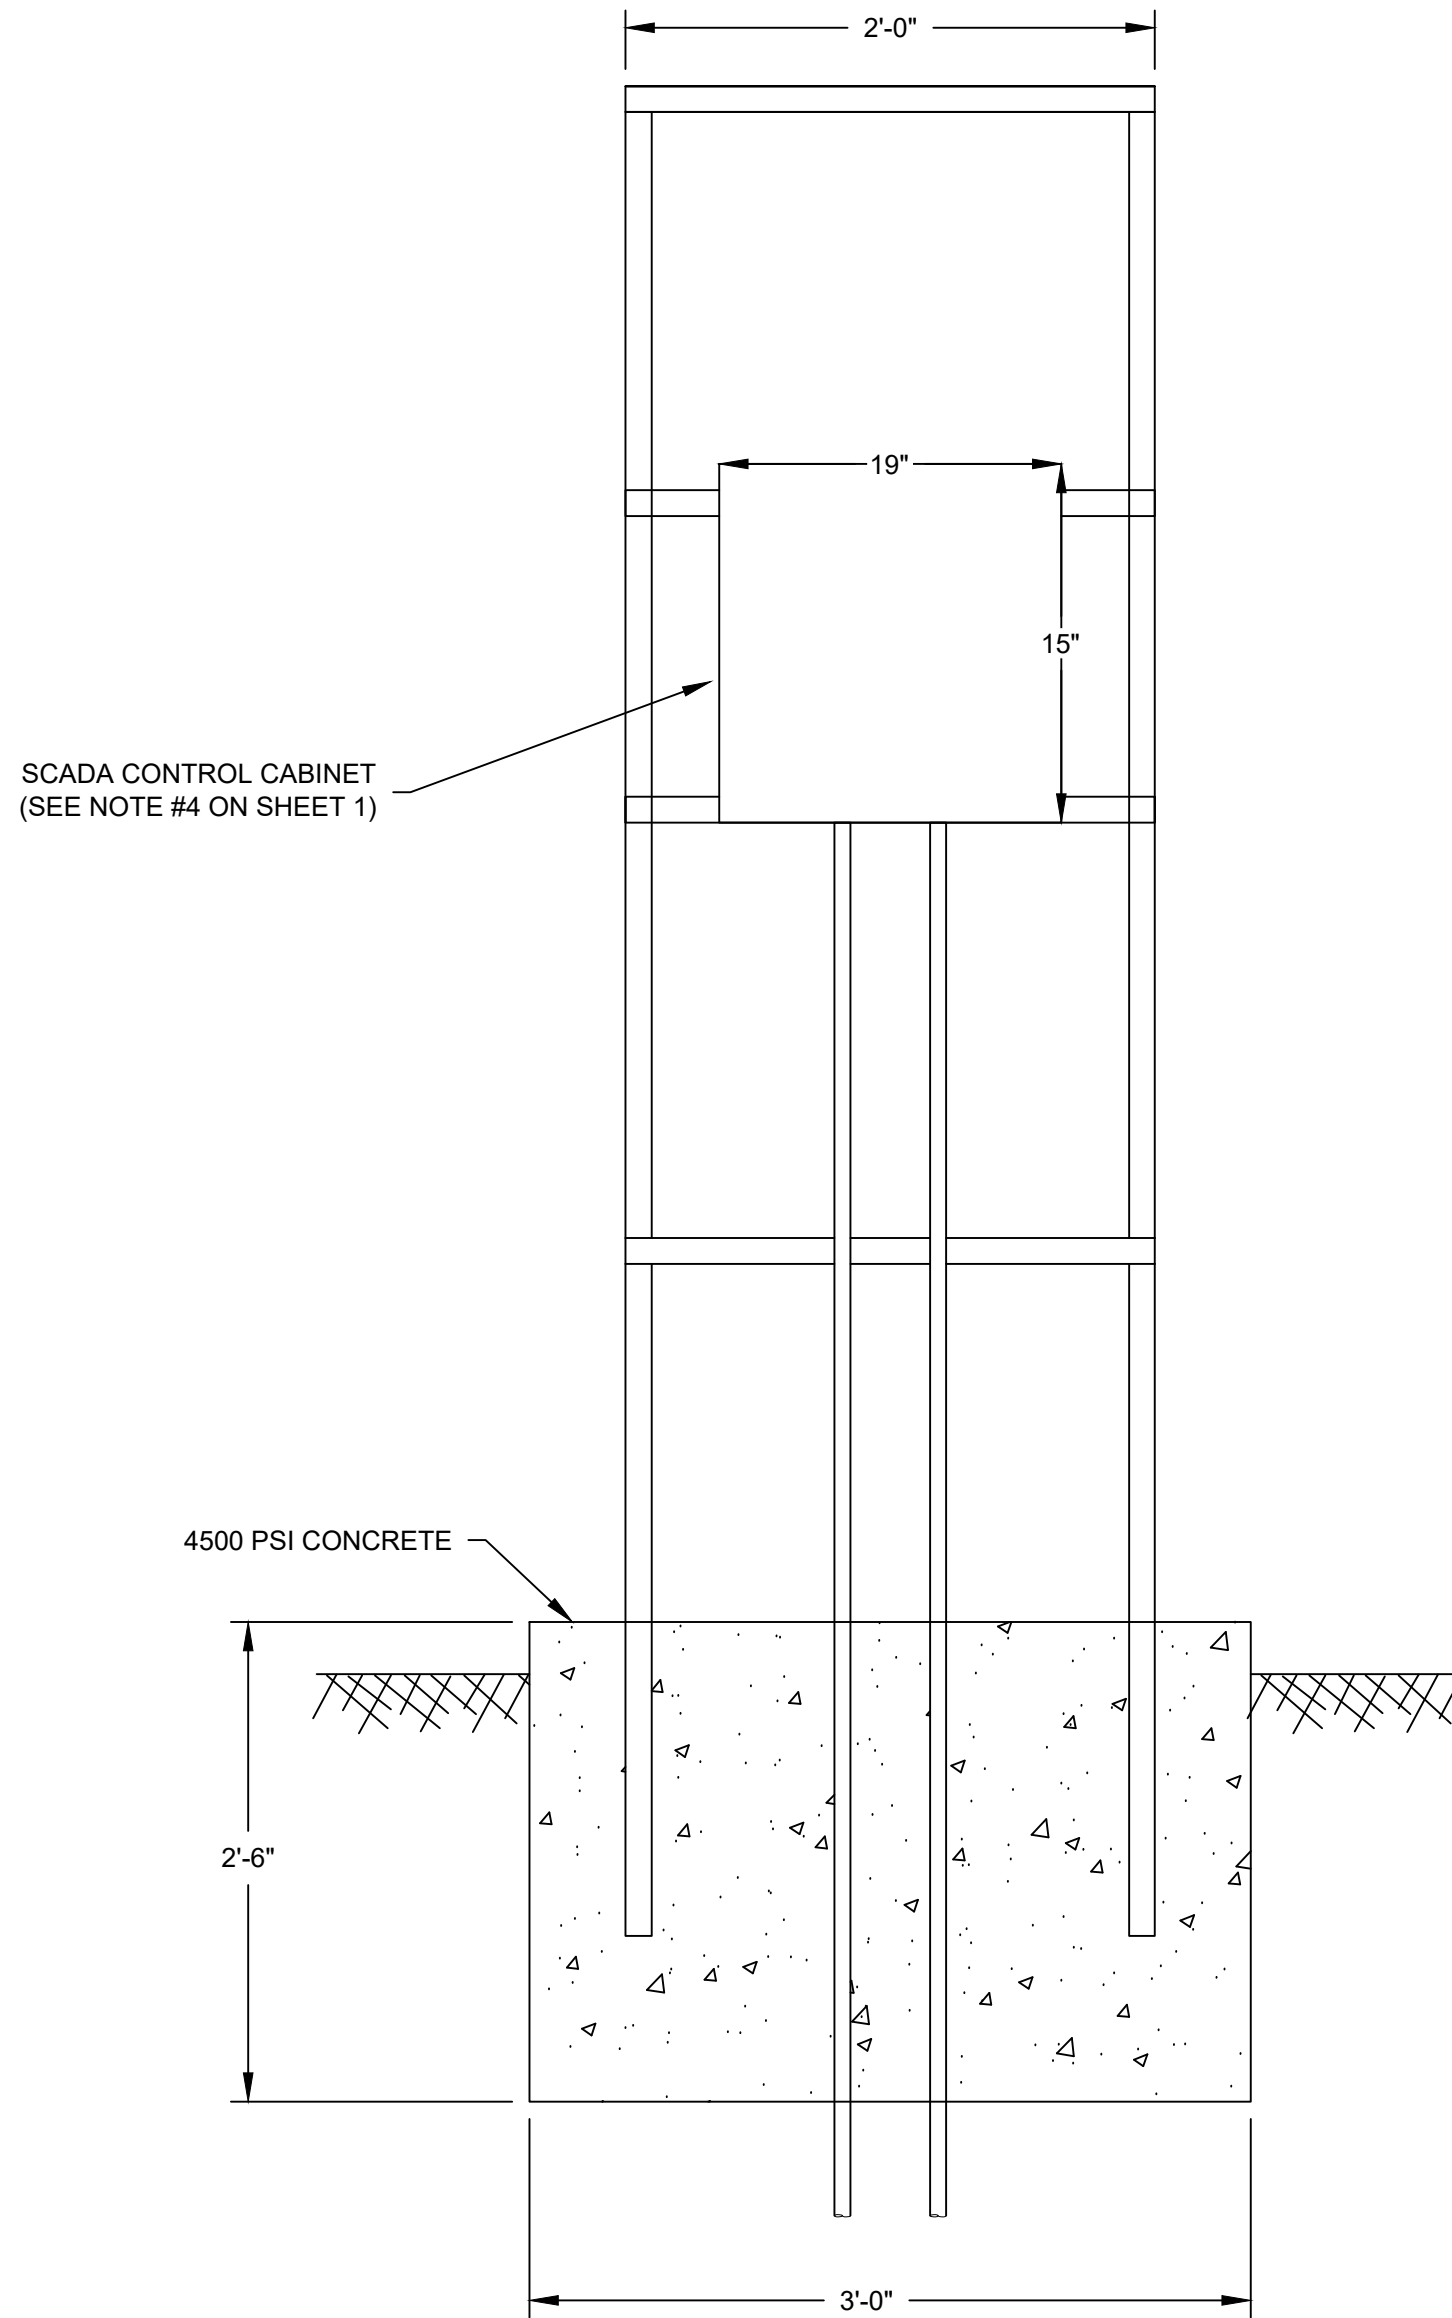

SCADA CONTROL PANEL AND
METER SUPPORT RACK FOR
DYNASONIC METER

N.T.S.



CITY OF PORTLAND
DEPARTMENT OF UTILITIES

REVISION NO: 1
DATE:08/30/2024

WW-17 SHEET #2