




CITY OF PORTLAND  
 DEPARTMENT OF UTILITIES - SEWER  
 STANDARD SEWER DETAILS

REVISION NO: 2  
 DATE: 01.27.2022

WW-06

NOTES:

1. CLEANOUT SHALL BE LOCATED 1' OUTSIDE OF THE ROW, IN THE PUDE OR 1' FROM BACK OF SIDEWALK.
2. CLEANOUT SHALL BE LOCATED IN SOFT SURFACE. CLEANOUTS SHALL NOT BE LOCATED IN ASPHALT OR CONCRETE SURFACES WITHOUT PORTLAND DEPARTMENT OF UTILITY APPROVAL.
3. SIDEWALK SHALL BE STAMPED WITH A 1"X1"- "S" AT BACK OF CURB WHERE CLEANOUT IS PLACED. PLUMBER SHALL INSTALL SERVICE LINE PER UPC.
4. CLEANOUTS SHALL BE INSTALLED AT BENDS AND NO MORE THAN 75 FEET APART. BOXES ARE REQUIRED FOR ALL CLEANOUTS, CONCRETE BOX SHALL BE INSTALLED FOR CLEANOUT AT RIGHT-OF-WAY.
5. SERVICE LINE SHALL BE BEDDED AND BACKFILLED TO TOP OF PIPE WITH #57 STONE.
6. SEWER STUB SHALL BE CAPPED AND LOCATED WITH GREEN STAKE. REMOVE CAP AND CONNECT 6-INCH CLEANOUT ASSEMBLY AS SHOWN.
7. IF CONNECTING TO EXISTING CLAY PIPE, THEN A STRONG-BACK FERNCO ADAPTOR SHALL BE USED AT CONNECTION FROM PIPE TO CLAY.

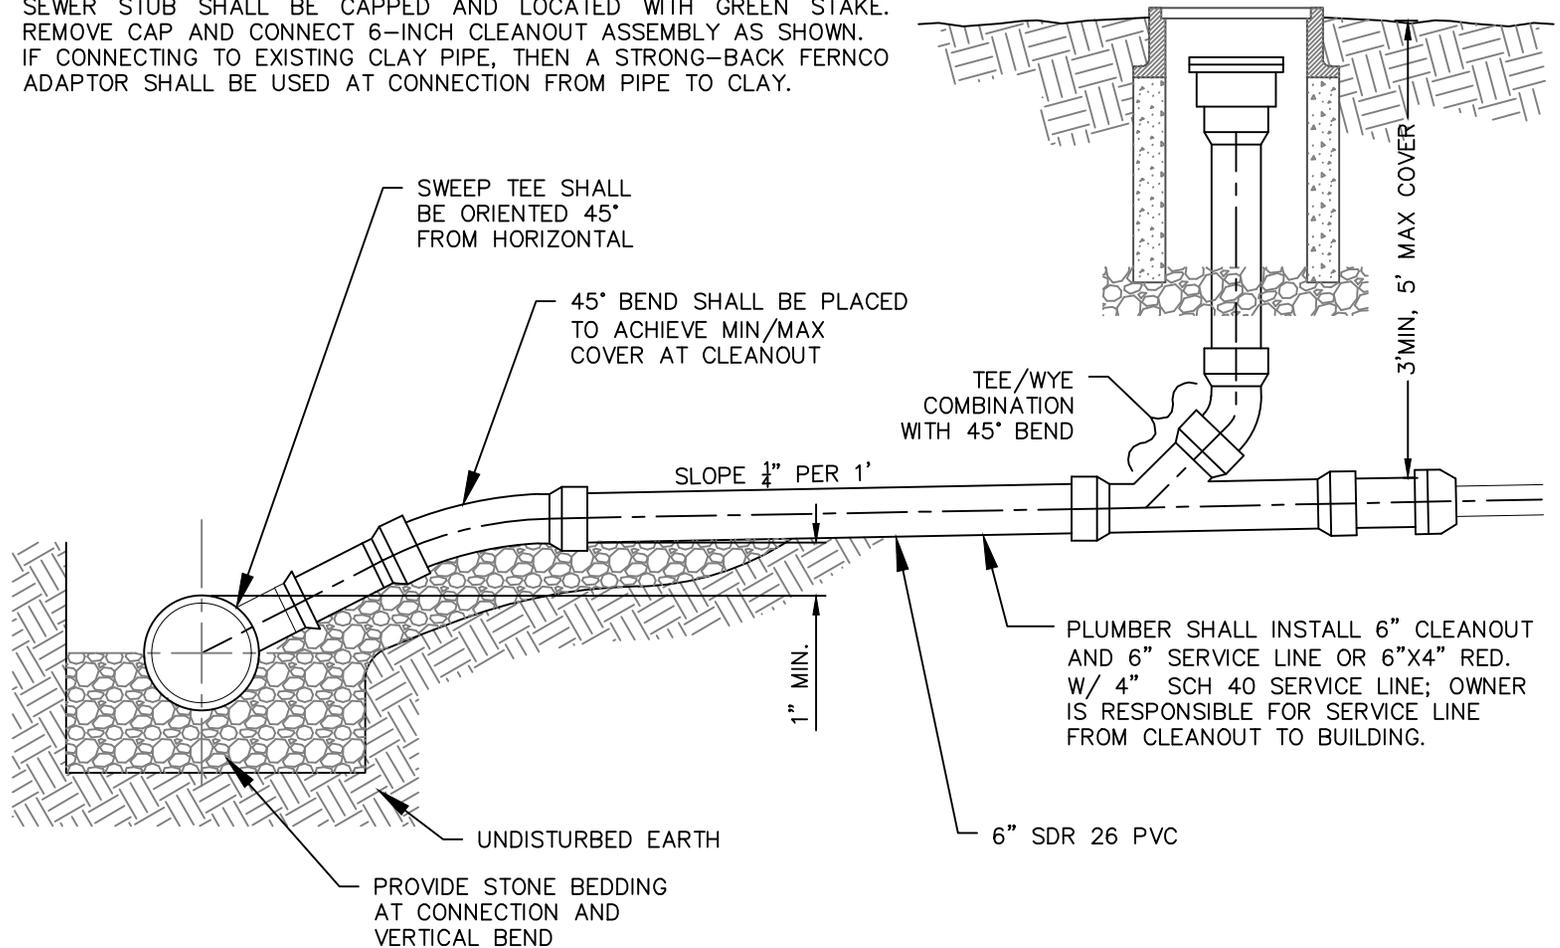

SEWER SERVICE DETAIL

N.T.S.